
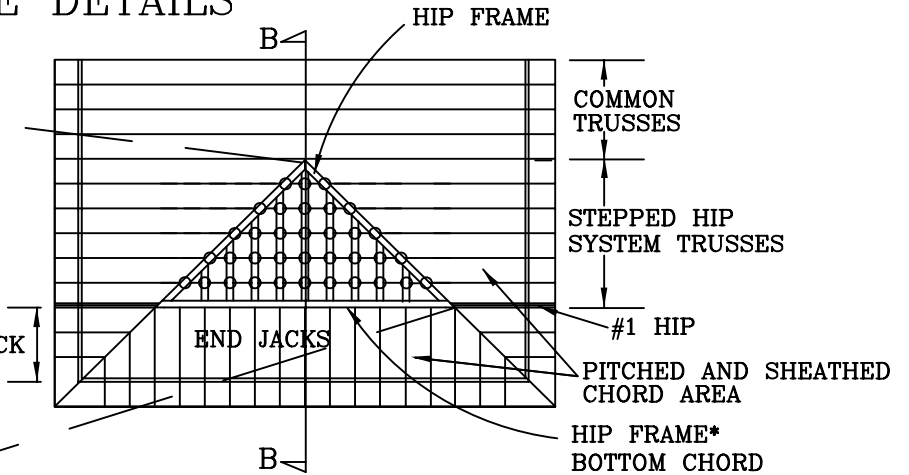


# \* HIP FRAME DETAILS

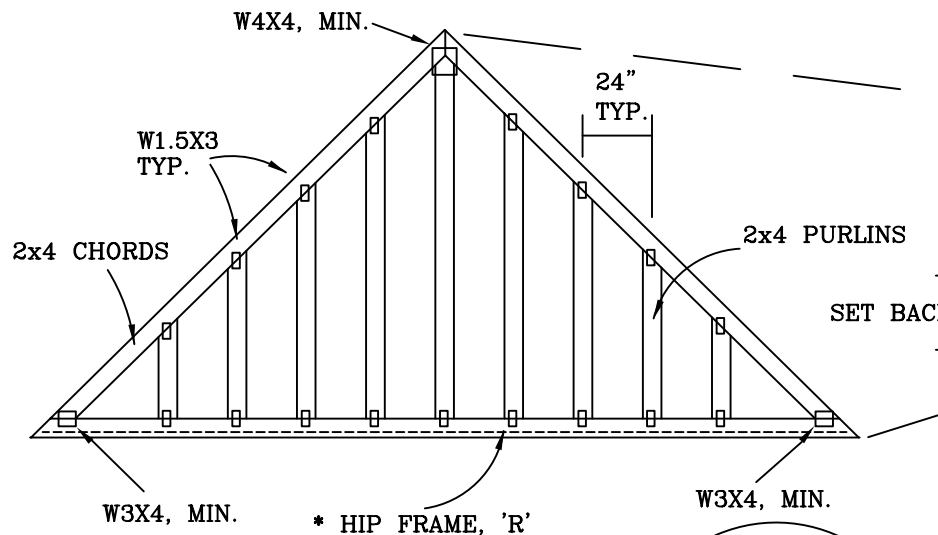

○ ATTACH HIP FRAME TO FLAT CHORDS OF STEPPED HIPS AT ALL OVERLAPPING POINTS WITH 2-10d (0.148"x3") COMMON NAILS. BOTTOM CHORD OF HIP FRAME TO BE ATTACHED TO #1 HIP WITH 10d COMMON (0.148"x3") NAILS @ 6" O.C. MAXIMUM SPACING.


HIP FRAME STOPS AT PLUMB CUT OF JACKS TO MAINTAIN PITCH CONTINUITY.

USE THIS DETAIL FOR ASCE 7-02 OR ASCE 7-05 WIND, 110 MPH, 30' MEAN HEIGHT, ENCLOSED BUILDING, EXP. C, RESIDENTIAL, WIND TC DL=4.2 PSF, Kzt=1.00

\* HIP FRAME LUMBER IS SPF, SO. PINE, HF, OR DFL STANDARD, STUD GRADE, OR BETTER.

SEE ENGINEER'S SEALED DESIGN FOR SETBACK, LUMBER, PLATING, LOADING AND DURATION FACTOR REQUIRED.

'R' HIP FRAME CHORDS MAY BE TRIMMED UP TO 2" TO FIT. PURLINS MUST BE INTACT AND PROPERLY ATTACHED.

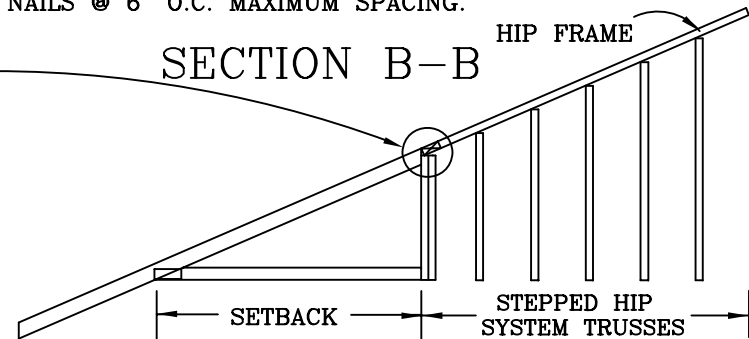

HIP FRAME - PROVIDED BY TRUSS MANUFACTURER. HIP FRAME IS DESIGNED TO PROVIDE BRACING FOR FLAT TOP CHORDS OF HIP FRAME SYSTEM WHERE INDICATED. STRUCTURAL PANELS MUST BE PROPERLY ATTACHED DIRECTLY TO HIP FRAME PURLINS.



Building Components Group Inc.

Earth City, MO 63045

**\*\*WARNING\*\* READ AND FOLLOW ALL NOTES ON THIS SHEET**  
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow BCSI (Building Component Safety Information, by TPI and WTCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural panels and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3 & B7. See this job's general notes page for more information.

**\*\*IMPORTANT\*\* FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR.**  
ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design, any failure to build the truss in conformance with TPI, or fabricating, handling, shipping, installing & bracing of trusses. ITWBCG connector plates are made of 30/18/18GA (W.H/S/S) ASTM A653 grade 37/40/60 (K/W/H/S) galv. steel. Apply plates to each face of truss, positioned as shown above and on Joint Details. A seal on this drawing or cover page indicates acceptance and professional engineering responsibility solely for the truss component design shown. The suitability and use of this component for any building is the responsibility of the Building Designer per ANST/TPI 1 Sec. 2.  
ITW-BCG: www.itwbcg.com; TPI: www.tpinet.com; WTCA: www.sbcindustry.com; ICC: www.iccsafe.org

REF	HIP FRAME
DATE	1/1/09
DRWG	HIPFRAME0109